
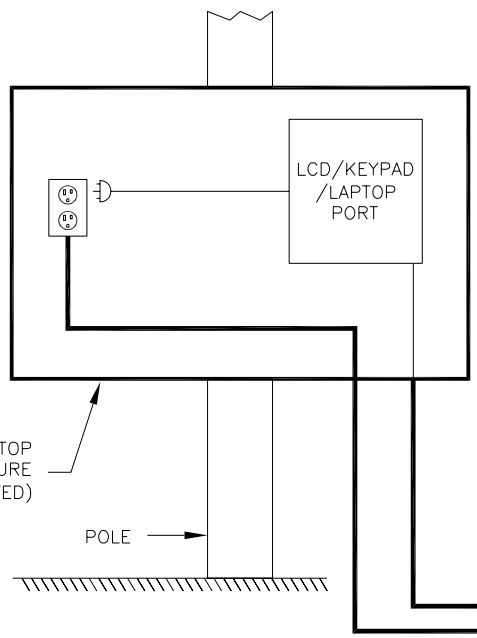


REV.	DATE	DESCRIPTION	BY	APPR.
------	------	-------------	----	-------

NOTES:  
 1. THIS IS A RISER DIAGRAM ONLY.  
 ACTUAL TRAFFIC CABINET LAYOUT WILL DIFFER.

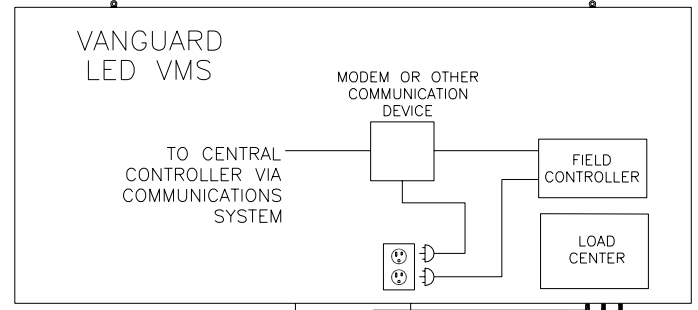

EARTH GROUND—  
 RODS AND WIRING  
 AT BASE OF SIGN

POWER SOURCE:  
 120/240 VAC, 3 WIRES PLUS  
 EARTH GROUND, WIRE SIZED AS  
 NEEDED. THE EARTH GROUND  
 WIRE FROM THE POWER SOURCE  
 MUST BE SIZED ACCORDING TO THE  
 NEC.

1 1/2" CONDUIT REQUIRED.

SIGNAL CABLE:  
 ONE 4 PAIR, 24 AWG SHIELDED CAT 5  
 DAK. P.N. W-1467

3/4" CONDUIT REQUIRED

BRANCH CIRCUIT:  
 120 VAC 2 WIRES PLUS EARTH  
 GROUND, 20 AMP CIRCUIT; WIRES  
 SIZED AS NEEDED.

1 1/2" CONDUIT REQUIRED.

THE CONCEPTS EXPRESSED AND DETAILS SHOWN ON THIS DRAWING ARE CONFIDENTIAL AND PROPRIETARY. DO NOT REPRODUCE BY ANY MEANS, INCLUDING ELECTRONICALLY WITHOUT THE EXPRESSED WRITTEN CONSENT OF DAKTRONICS, INC. COPYRIGHT 2004 DAKTRONICS, INC.

DAKTRONICS, INC. BROOKINGS, SD 57006

PROJ:

TITLE: SYSTEM RISER DIAGRAM, LAPTOP INTERFACE ENCLOSURE

DES. BY: MWANHOF DRAWN BY: WLTUCKE DATE: 20 MAY 04

REVISION 00 APPR. BY: NONE SCALE: NONE 1100-R01A-212545